




Northwest Washington
Indian Health Board

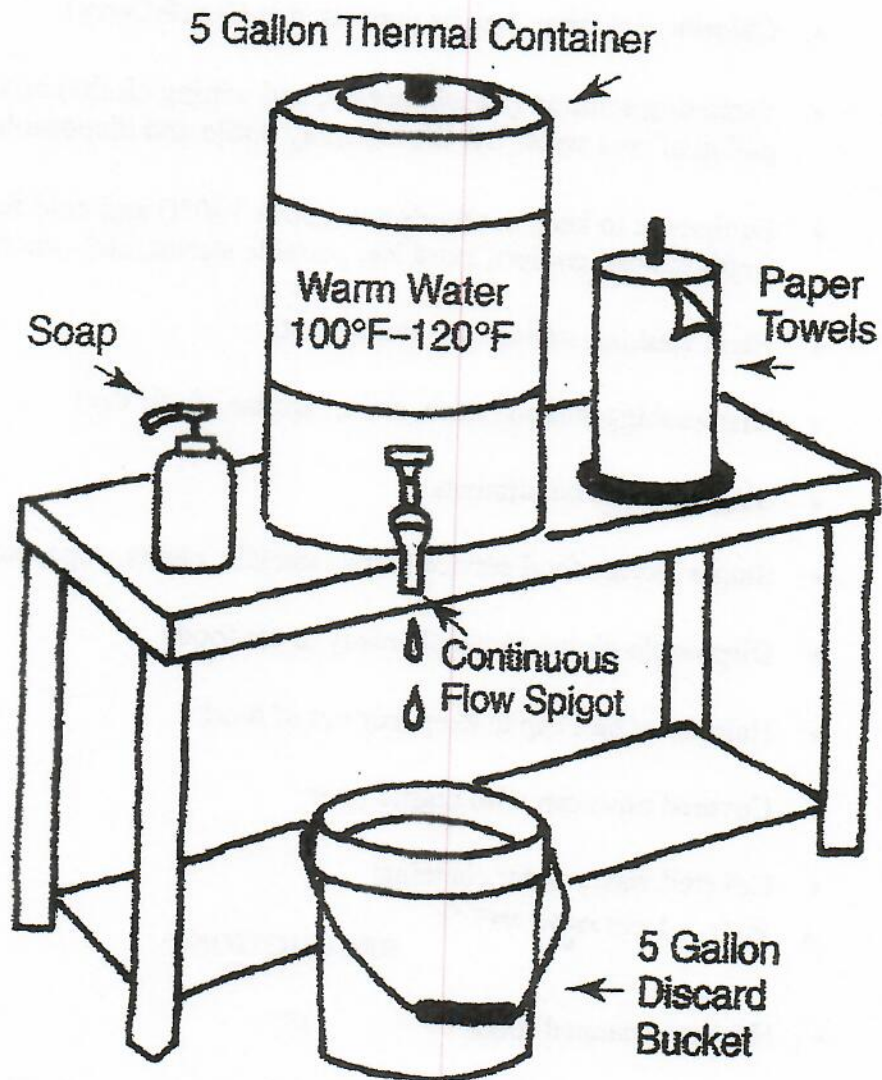

The temporary hand washing station shall consist of at least a 5-gallon insulated container with spigot that provides a continuous flow of warm water (100°F—120°F) running water, soap, paper towels and a 5-gallon bucket to collect the dirty water.